


REV	ZONE	REVISION	DATE	ECN	NAME	CHKD
B-1	ALL	RELEASE TO PRODUCTION	6/29/17	PXCC0099	GES	KMD

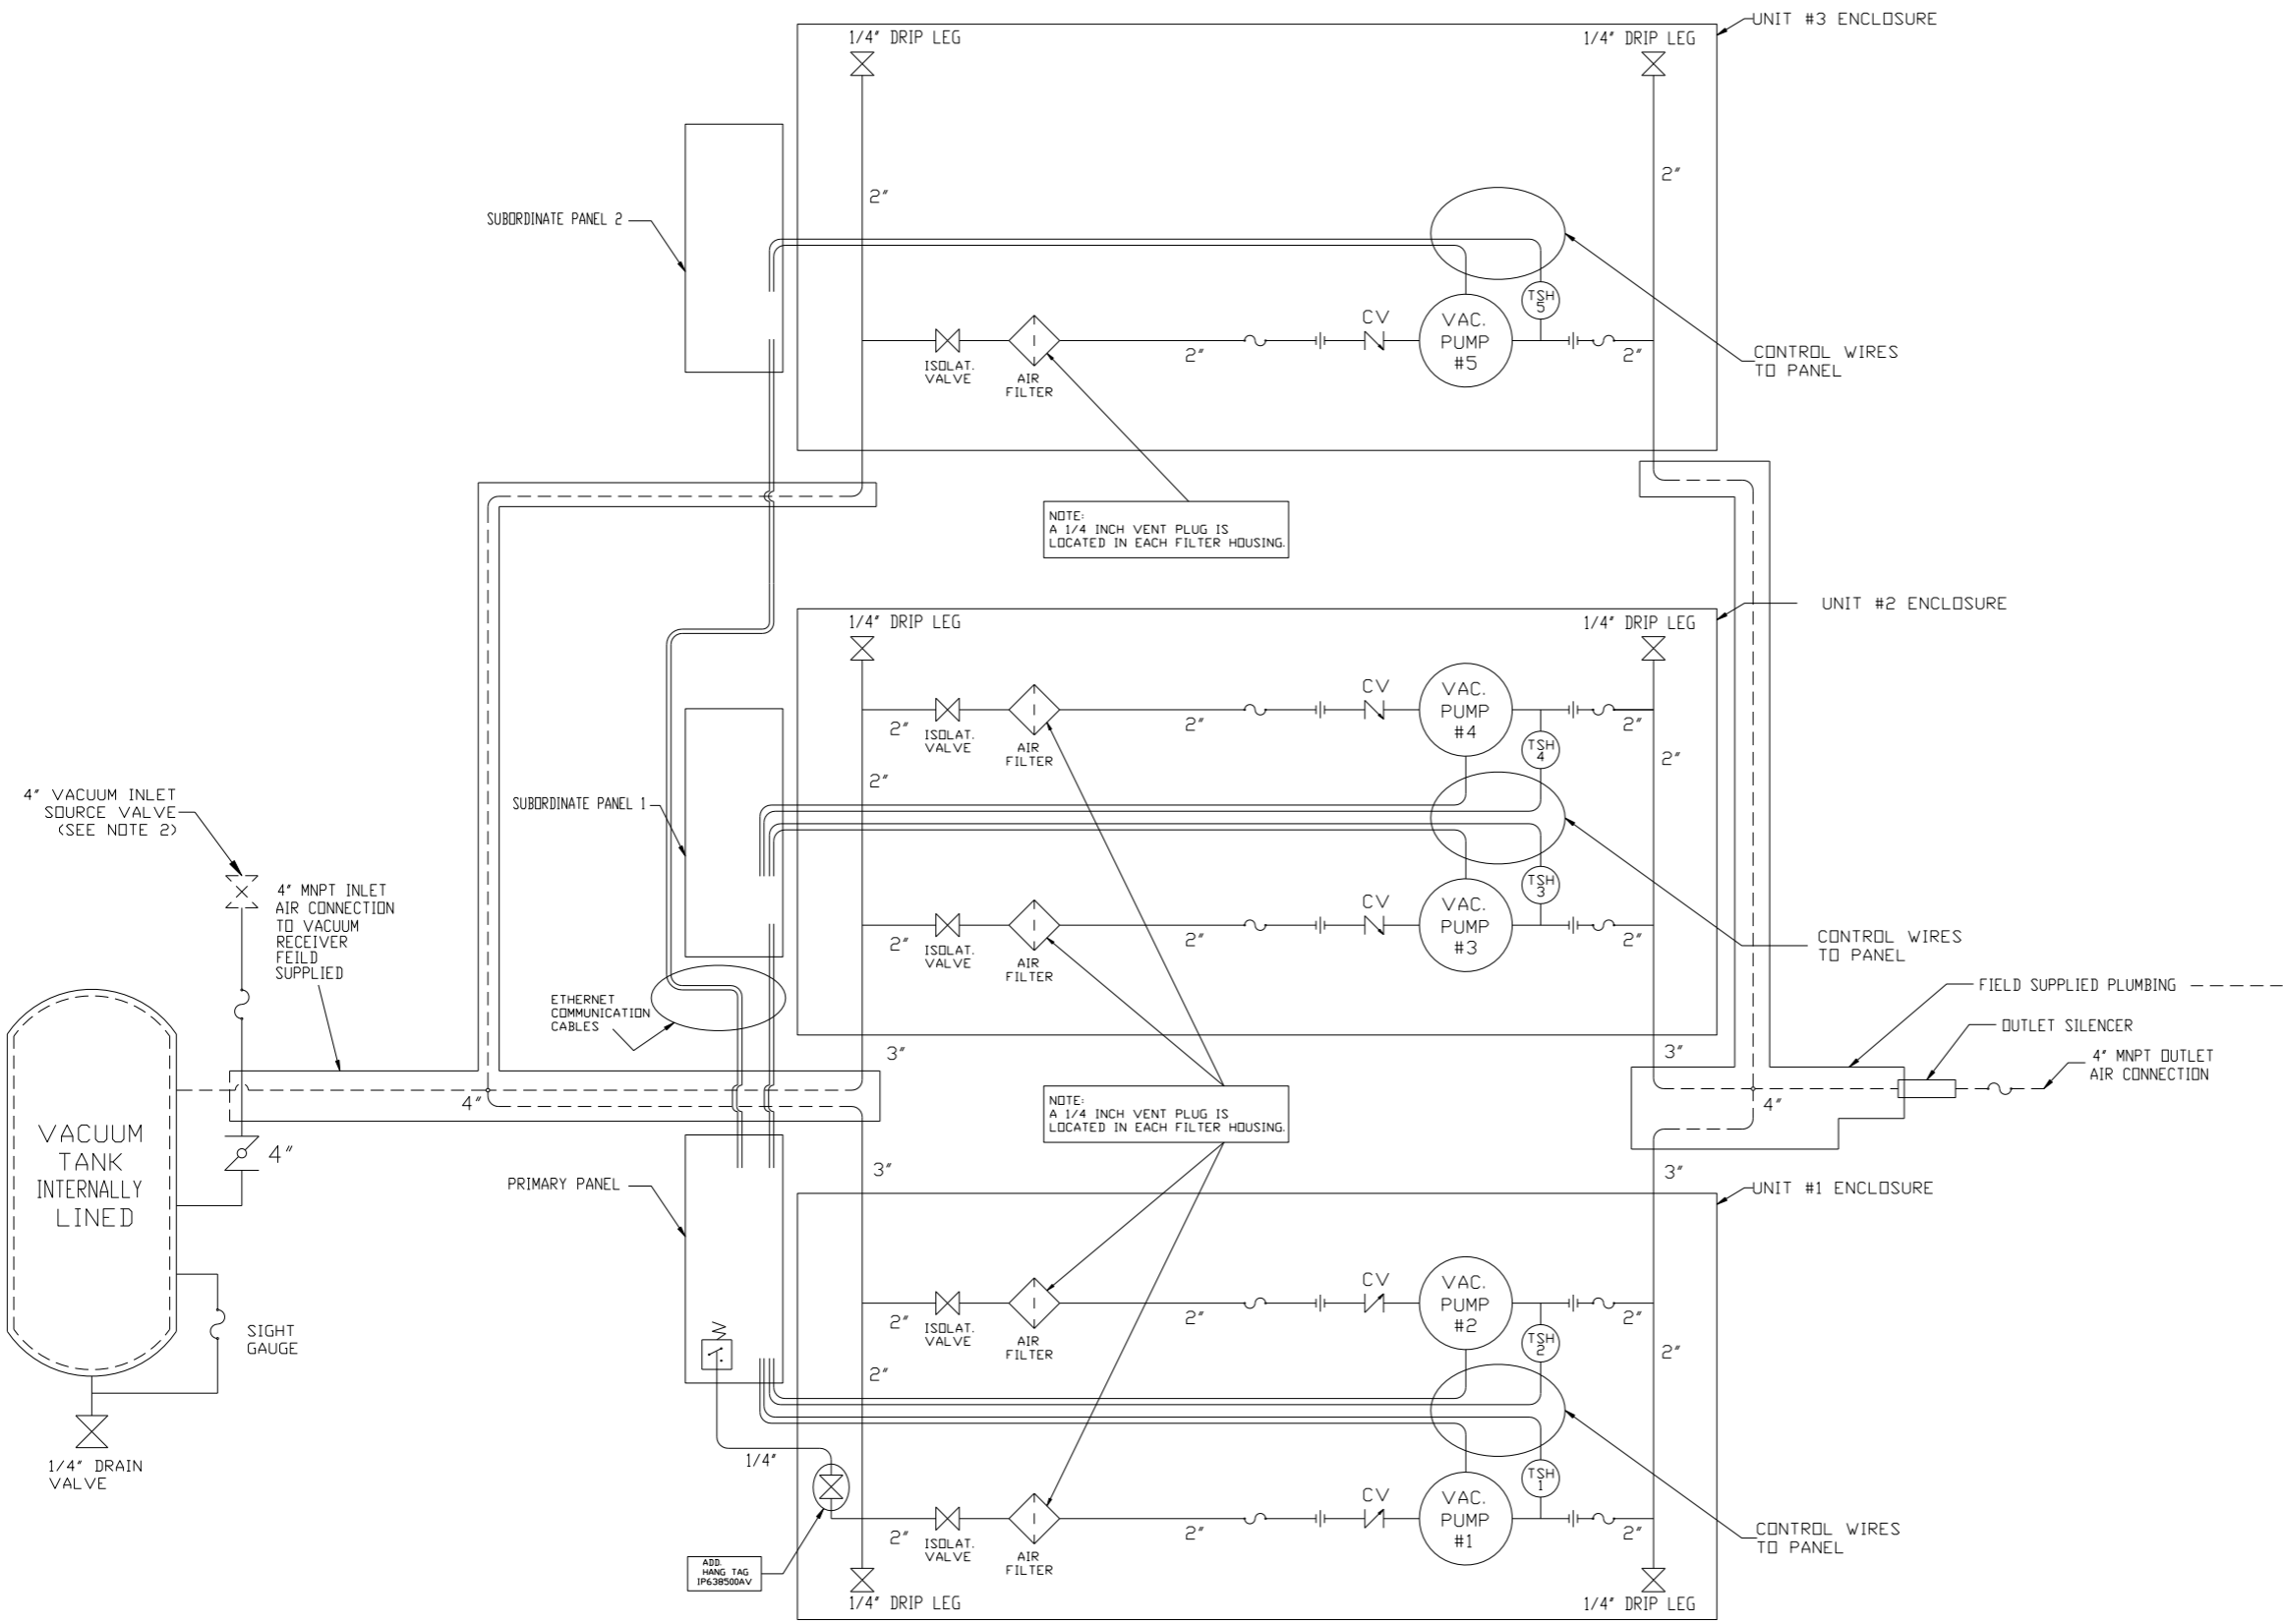

NOTE:
A 1/4 INCH VENT PLUG IS
LOCATED IN EACH FILTER HOUSING.

NOTE:
A 1/4 INCH VENT PLUG IS
LOCATED IN EACH FILTER HOUSING.

- NOTES:
- 1) TSH - TEMPERATURE SWITCH HIGH
 - 2) PER NFPA THE SYSTEM WILL REQUIRE A SOURCE VALVE (SUPPLIED BY OTHERS).
 - 3) FIELD SUPPLIED PLUMBING IS INDICATED BY HIDDEN LINES. - - - - -

LEGEND

(TSH)	TEMP. SWITCH	(Symbol)	VACUUM TRANSDUCER
(Diamond)	AIR FILTER	(Symbol)	CHECK VALVE
(X)	BALL VALVE	(Symbol)	FLEX LINE
(Symbol)	BUTTERFLY BALL VALVE	(Symbol)	UNION

SYMBOL LEGEND	ADDITIONAL CONTROL REQ'D	Drawings to conform to the current revision of the following ANSI standards:
⊖ = MINUS DRAFT	⊕ = PLUS DRAFT	Y14.3 Multi and sectional view dgs.
TOLERANCES NOT SPECIFIED	AUTOCAD REL2014LT	Y14.5M Dimensioning and tolerancing
.XX ±	INCH	DO NOT SCALE DRAWING FOR DIMENSIONS
.XXX ±		Sheet 2 of 2
<DEG. > ±		SCALE 1:18
CONFIDENTIAL DISCLOSURE This drawing is the property of POWEREX, INC. of the SCOTT FETZER COMPANY and subject to return on demand. Its contents are confidential and must not be copied or submitted to outside parties for use or examination.		
DRAWN BY	CHECKED BY	APPROVED BY
GES	KMD	GES
6/29/17	6/29/17	6/29/17
MATERIAL N/A		
PART NAME		
LAB CLAW ENCLOSED		
PENTAPLEX VACUUM		
DWG NO	SIZE	
LCEP0755	D	